



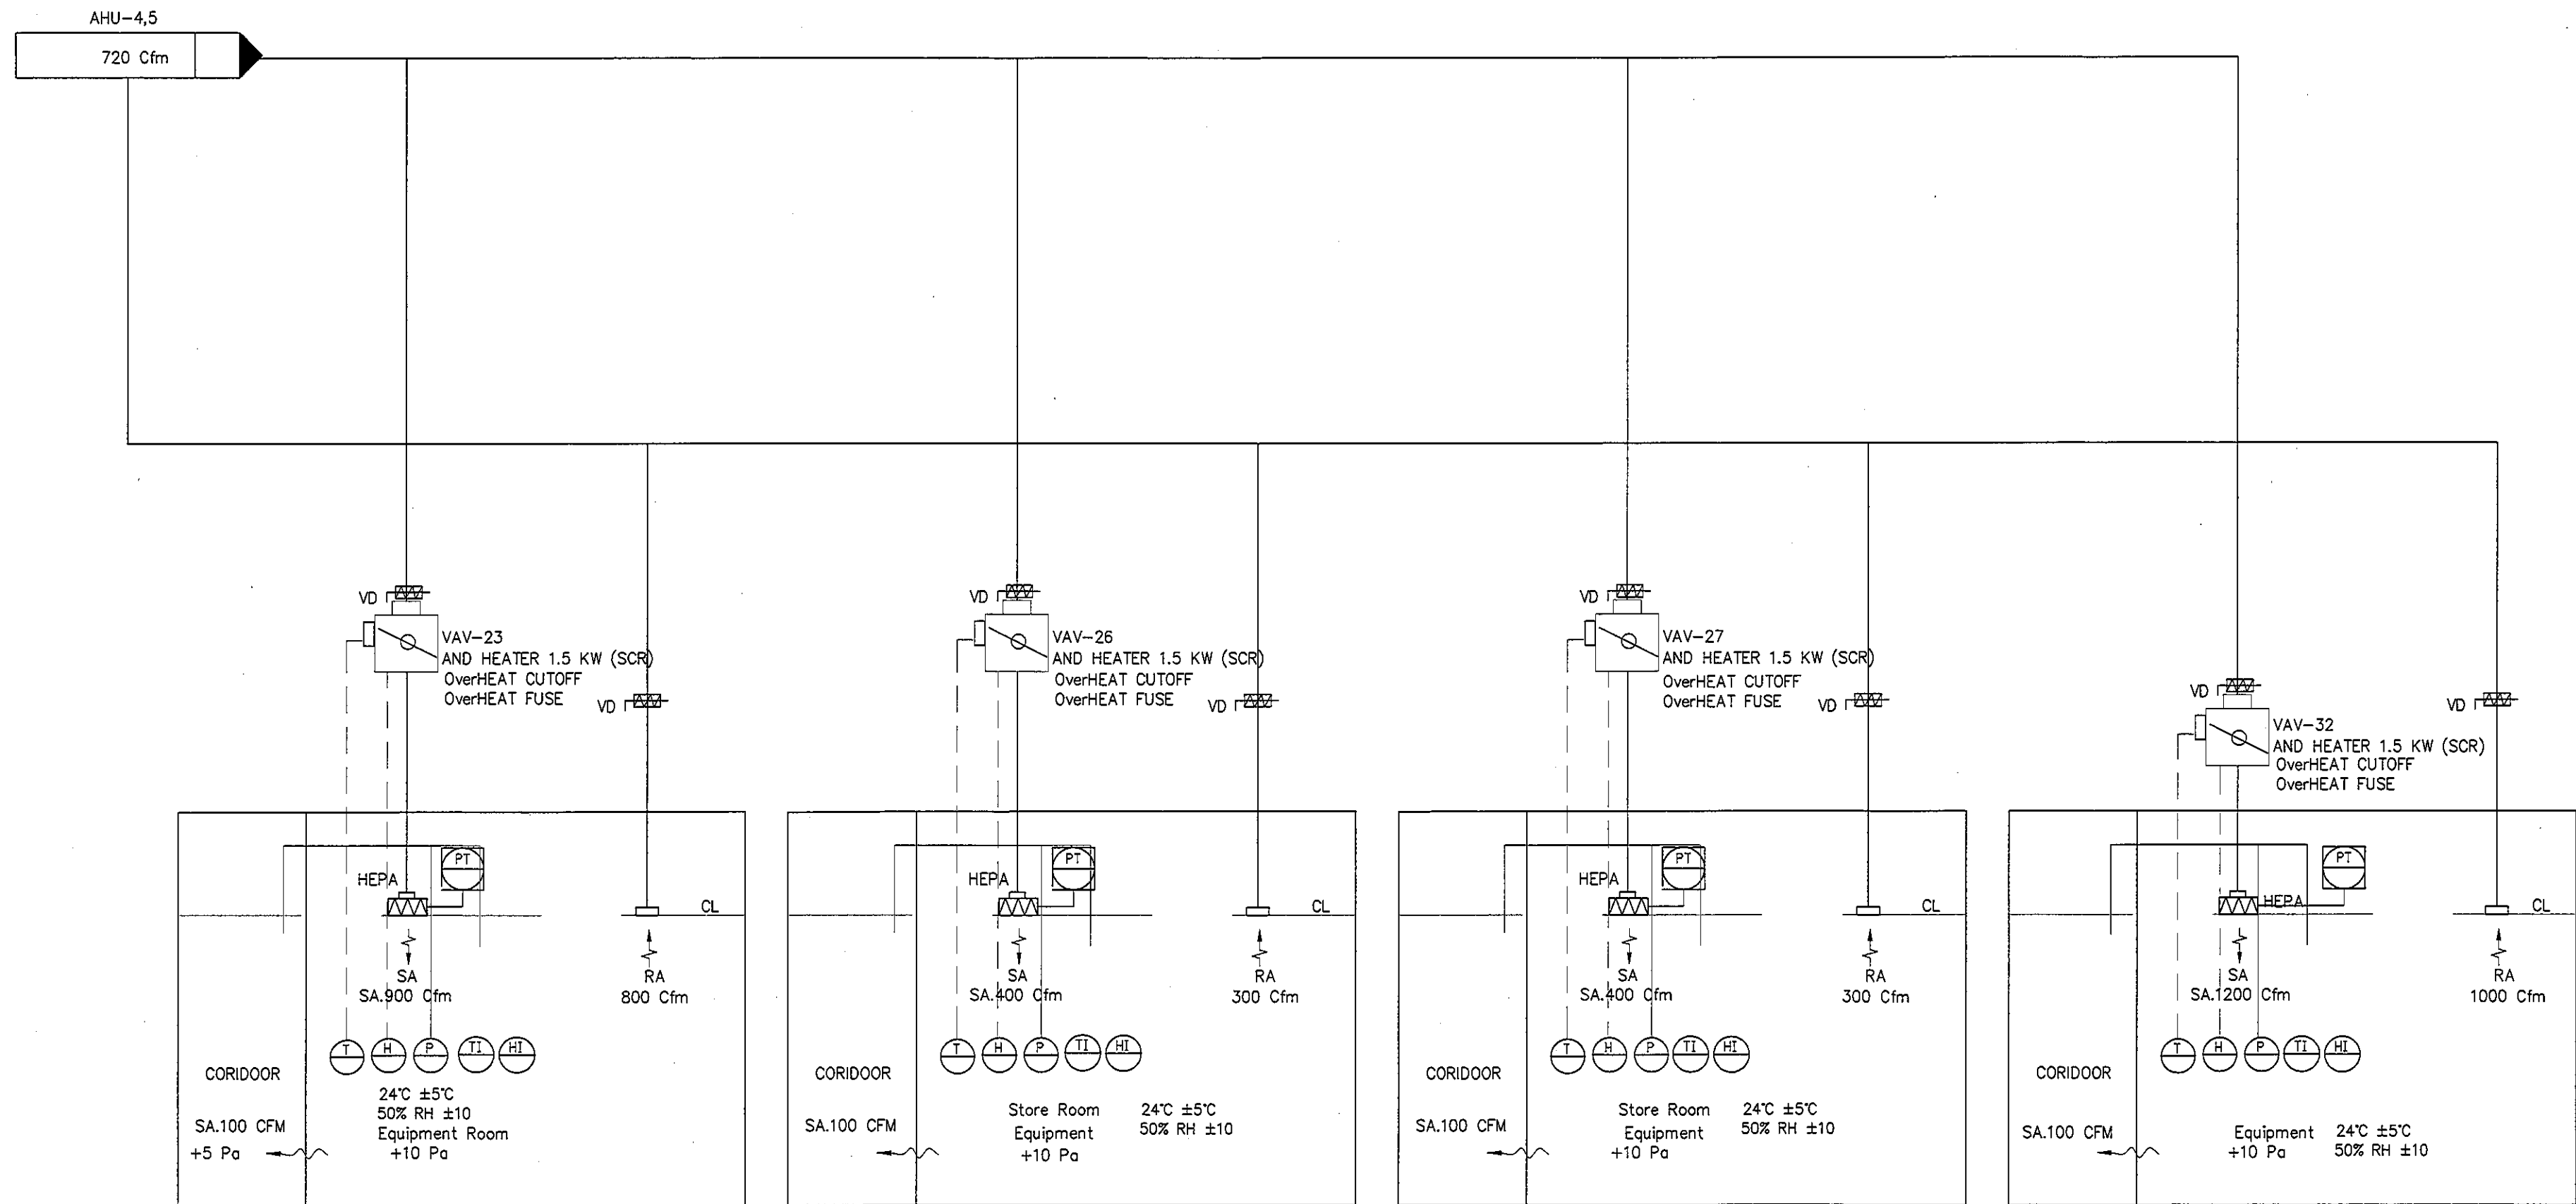

- (F) FLOW SWITCH STATUS
- (S) SMOKE DETECTOR ON-OFF
- (PT) PRESSURE TRANSMITTER WITH DISPLAY
OUT PUT 4-20 mA or 0-10 V
- (H) HUMIDITY SENSOR WITH DISPLAY
OUT PUT 4-20 mA or 0-10 V
- (T) TEMPERATURE TRANSMITTER WITH DISPLAY
RTD OUT PUT 0-20 mA or 0-10 V
- (M) MOTORIZED DAMPER WITH PID CONTROL
1 AI, 1 AO
- (N) ON/OFF DAMPER WITH CONTROLLER
2 DI
- (P) DIFF PRESSURE INDICATOR
INDICATOR (WITH DISPLAY)
- (HI) HUMIDITY SENSOR
INDICATOR (WITH DISPLAY)
- (TI) TEMPERATURE TRANSMITTER
INDICATOR (WITH DISPLAY)



ALL AHU AND OAU CONTROL BY DDC CONTROLLER STAND ALONE

TYPICAL DETAIL AHU-4,5
SCALE NTS.

REVISION	
NO.	DESCRIPTION
1.	04/12/2563
2.	01/02/2564
3.	
4.	
5.	
6.	
7.	
8.	
9.	

S2 all co.,ltd.

PROJECT :

โครงการพัฒนาระบบปรับอากาศ
พื้นที่ห้องผู้ป่วย ส.9
และพื้นที่ห้องผู้ป่วย ส.9
ฝั่งตะวันออก
(ชั้น 9, NICU)

LOCATION :

สถาบันสุขภาพเด็กแห่งชาติมหาราชินี
420/8 ถนนราชวิถี แขวงทุ่งพญาไท
เขตราชเทวี กรุงเทพมหานคร 10400

CLIENT :

โรงพยาบาลเด็กมหาราชินี
80 พรรษา มหาราชินี
มูลนิธิโรงพยาบาลเด็ก

ARCHITECT :

จิราญ พรหมดี 2563 11944

INTERIOR :

จิราญ พรหมดี 2563 11944

ENGINEER :

STRUCTURAL ENGINEER :

พรเทพ เข้มแข็งกุล ภ.บ.54050
ศิริวัฒน์ ชุ่มน้อย ส.บ.12008

ELECTRICAL ENGINEER :

ปริญญ์ บัวศิริศักดิ์ ส.บ. 5936

SANITARY ENGINEER :

ณัฐพล ปิยะชาลย์ ภ.บ. 1816

MECHANICAL ENGINEER :

ณัฐพล ปิยะชาลย์ ส.บ. 3352

DRAWN : 999

CHECK : 999

JOB No : 999

DATE : 99/99/9999

SCALE : NTS.

SHOWING :

TYPICAL DETAIL
AHU 4,5 (2)

AC-14

ALL DESIGN AND DRAWING ARE
THE PROPERTY OF
S2 ALL Co.,Ltd.